

BRUHAT BANGALORE MAHANAGARA PALIKE

YELAHANKA ZONE, BYATARAYANAPURA DIVISION

Lead Statement for Srinivasapura Dumping Yard for Ward No. 10,
Vidyaranyapura Sub Division.

Lead Distance

1. From BBMP Sub Division office to Devi Circle	1.50 Kms
2. From Devi Circle to Thirumala Daba	2.00 Kms
3. From Thirumala Daba to 3 rd Cross SBI Bank	2.00 Kms
4. From 3 rd Cross SBI Bank to Sheshadripuram College	0.50 Kms
5. From Sheshadripuram College to Police Station	0.80 Kms
6. From Police Station to Kogilu Cross	0.60 Kms
7. From Kogilu Cross to Srinivasapura	4.00 Kms
8. From Srinivasapura to Dumping Yard	<u>0.50 Kms</u>
Total	11.90 Kms


Certificate:

1. Certified that the Srinivasapura Dumping Yard is the approved dumping yard for ward no. 10 BBMP
2. BBMP Sub Division office Vidyaranyapura is taken as the centre place for calculating the lead distance for ward no. 10.
3. The above distance is the shortest distance for calculating the lead.


Assistant Engineer
Ward No. 10


Assistant Executive Engineer
Vidyaranyapura Sub Division

LEAD CHART FOR DUMPING YARD FOR WARD NO 10

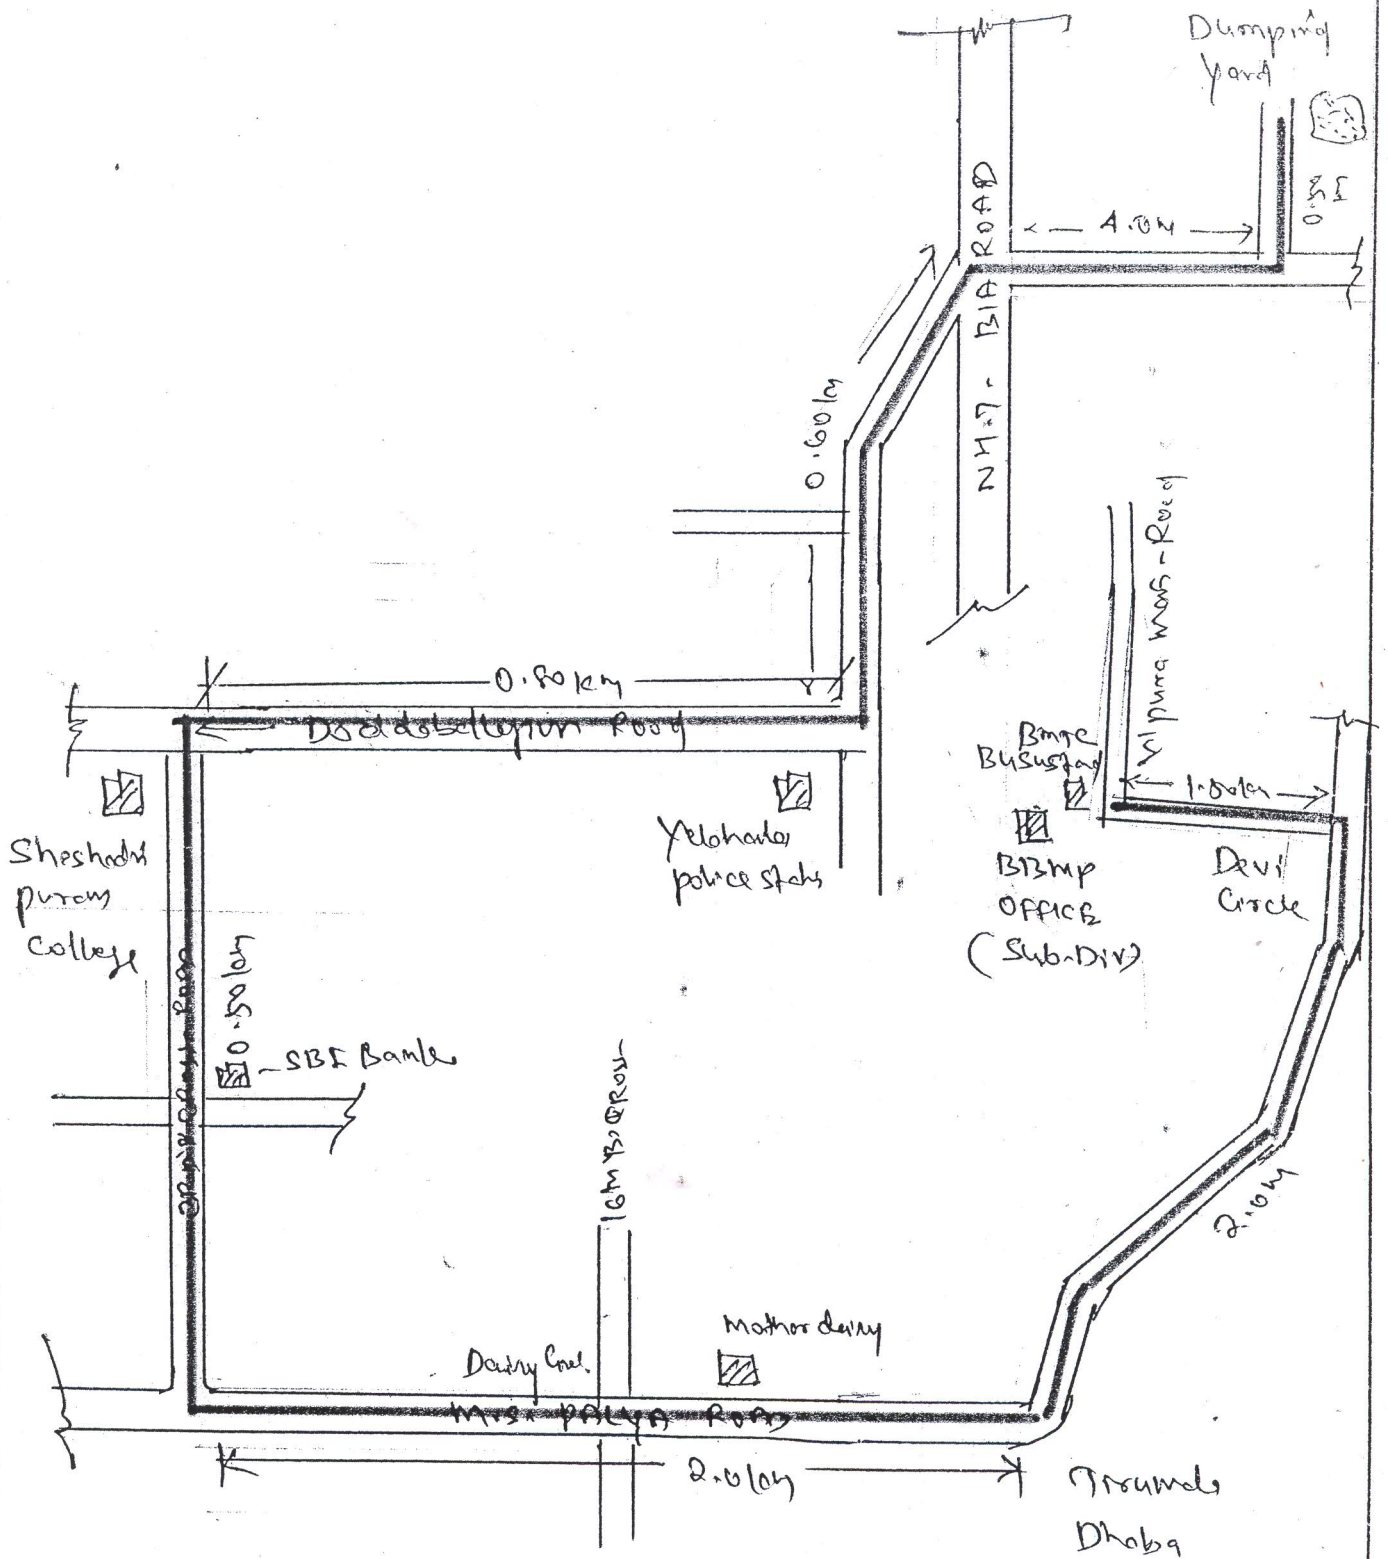

Jadhav
AE W-10

[Signature]
ಸಹಾಯಕ ಕಾರ್ಯಪಾಲಕ ಅಭಿಯಂತರರು
ವಿಜ್ಞಾನಪ್ರಕೃತಿ ಉಪ ವಿಭಾಗ
ಯಲಹಂಕ ಪರಿಯ,
ಬಿ. ಬಿ. ಮ. ಕಾ. ಬೆಂಗಳೂರು-97